




ST. JOSEPH'S

COLLEGE OF ENGINEERING
AND TECHNOLOGY,
- PALAI -

Choondacherry P.O., Palai, Kottayam Pin 686579, Kerala, India
Phone: +91 4822-239700, 239301, 239302
Email: info@sjcetpalai.ac.in • Website: www.sjcetpalai.ac.in

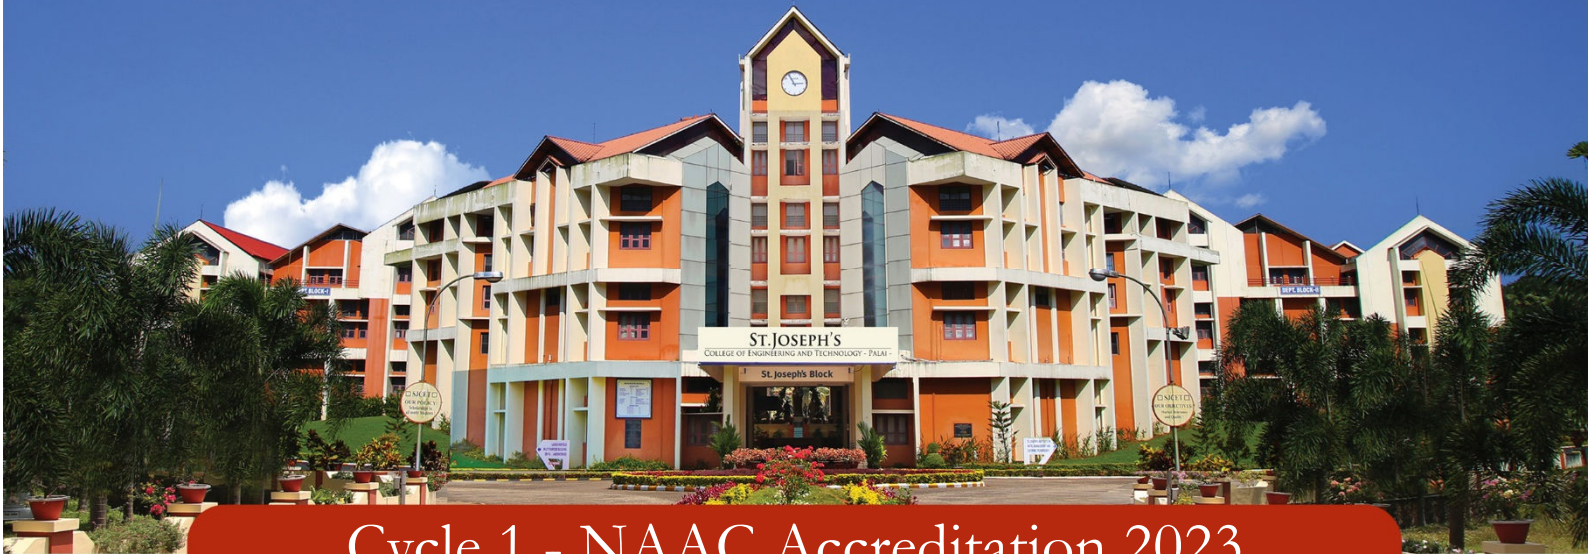

Cycle 1 - NAAC Accreditation 2023

Criterion - 4

Infrastructure & Learning Resources

4.3.1 Institution frequently updates its IT facilities including Wi-Fi


Submitted to:



National Assessment and Accreditation Council

Power Generator & 11 KV Substation (Legal Details)

| | |
|--------------------------|------------------------------------|
| Department/Amenity | Amenity |
| Name of the LAB/ Amenity | 11KV Substation and Generator Room |
| Location | Near College |
| Total floor Area | 102 m sq |

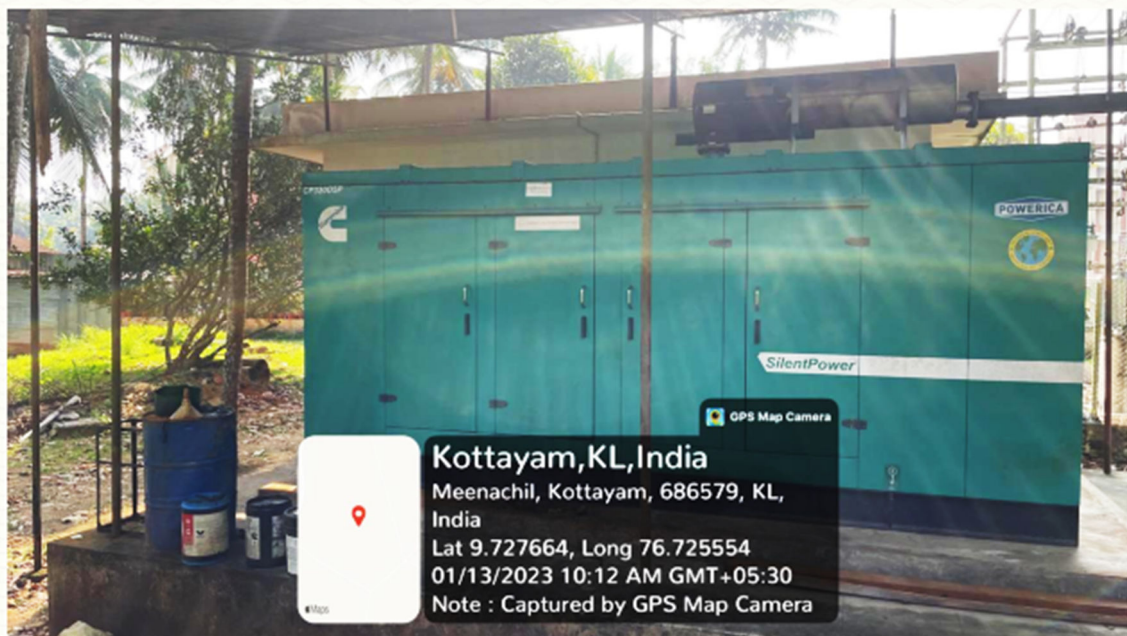



Government of Kerala
 Department of Electrical Inspectorate
Office of the Electrical Inspector
 Star Junction, M.C Road, Kottayam .P.O, Kottayam-01.
 Phone:- 0481 256887(2) Email:-eikottayam@gmail.com



File No. : B1-3339/21/EIK



From

To

M/s. The Principal,
 Diocesan Technical Education Trust, St.Joseph's College
 of Engineering & Technology, Choondachery,Pala.
 Pin:686579

Sir,

Sub:- Periodical inspection under Regulation 30 of the CEA (Measures relating to Safety and Electric Supply) Regulations, 2010 of the Electrical installation at the premises of M/s. St.Joseph's College of Engineering And Technology, Bharananganam, Pala - reg:
Ref:- Inspection for the year 2021-22

Please refer to the above. I am forwarding herewith the invoice bearing No : 4/715 dt. 05/07/21 for ₹ 78315/- towards the inspection fee for the year 2021-22.

You are requested to remit the inspection fee under the head of account of 0043-102 in any Govt. Treasury/Janasevana Kendram (FRIENDS), and the original chalan / receipt shall be forwarded to this office within 30 days of receipt of this letter failing which the electricity supply to the above premise is liable to be disconnected and the amount will be realized by revenue recovery proceedings.

Yours faithfully ,

[Signature]
 Deputy Electrical Inspector -lc

Case No. : OH0219

*To
 fo
 do needful in time
 Jy.
 13/8/21*

*R/- 78315/- as above may be
 paid before 31/8/21
 Jy 70/5/8/21*



Government of Kerala
 Department of Electrical Inspectorate
 Office of the Electrical Inspector
 Star Junction, M.C Road, Kottayam .P.O, Kottayam-01.
 Phone:- 0481 2568878, Email:-eikottayam@gmail.com



HT

Fee Calculation Statement / Invoice

Pdl. Inspn. as per Regn. 30 of the CEA (Measures relating to Safety and Electricity Supply) Regns., 2010 - for the year 2021 - 22.
 Fee as per Kerala Govt. Order G.O.(P) No.28/19/Fin dtd 08/03/19 & CEI's Order No.H1-4738/19/CEI dtd 27/03/19

File No. : B1-3339/21/EIK
 Case No. : **OH0219**
 Invoice No. : 4/715
 Date : 05/07/21

Name of Installation : **St.Joseph's College of Engineering And Technology, Bharananganam, Pala**
 Name & Address of the Consumer : **The Principal,, Diocean Technical Education Trust, St.Joseph's College of Engineering & Technology, Choondachery, Pala. Pin.686579**

Inspection Fee (2021 - 22)

| Particulars | Quantity/Unit | Rate (Rs.) | Fee (Rs.) |
|--|--------------------|------------------|------------|
| Aggregate Rating of HV Eqpmts. (< 6000kVA) | 315.00 kVA/kW/kVAR | 5.55/kVA/kW/kVAR | 1,748.25 |
| Aggregate Rating of Switches & Breakers | 51,090 Amps | 2.5/Amp | 127,725.00 |
| Aggregate Rating of MV Generators (kVA) | 547.50 kVA | 11/kVA | 6,022.50 |
| Aggregate Rating of LV/MV Equipments | 1,165.07 kVA/kW | 11/kVA/kW | 12,815.77 |
| Aggregate Rating of Capacitor | 80.00 kVAR | 11/kVAR | 880.00 |
| Earth Electrodes | 18 Nos. | 60/No. | 1,080.00 |
| Lightning Protection | 1 No. | 2760/No. | 2,760.00 |
| Special MV Equipments [UPS][Inverter] | 326.80 kVA | 11/kVA | 3,594.80 |

Total (Initial Inspection Fee) 156,626.32
 Periodical Inspection Fee (50%) 78,315.00
Periodical Inspection Fee ₹ 78315/-

(Rupees Seventy Eight Thousand Three Hundred and Fifteen Only)
 (Under Head of Account:- 0043-102-99)

മൊത്തം അടയ്ക്കേണ്ടത് (₹) റെഡ് കാർഡ് നമ്പർ
 പൂർണ്ണശോധനാഫീസ് 78315/ 0043-102-99

മുപ്പതിരവസത്തിനകം ഏതെങ്കിലും സർക്കാർ
 ഓഫീസിൽ / ജനസേവന കേന്ദ്രത്തിൽ / ഓൺ
 ലൈനിൽ (<https://etreasury.kerala.gov.in>) തുക
 അടച്ച് അസൽ ചലാൻ / മസീത് ഈ ഓഫീസിൽ
 ഹാജരാക്കേണ്ടതാണ്.

PIR Page No.:
 DCB Sl. No.: 511/21

[Signature]
 Deputy Electrical Inspector

... പൊട്ടികിടക്കുന്ന വൈദ്യുതകമ്പികളിൽ സ്പർശിക്കരുത് ...

cut here Please fill up the following part and return with the original chalan cut here

File No. : B1-3339/21/EIK DEI:- Anil Kumar V // AEI:- Naveen Samson

Case No. : **OH0219**
 Name & Address of the Consumer : **The Principal,, Diocean Technical Education Trust,, St.Joseph's College of Engineering & Technology,, Choondachery, Pala.**

DCB Sl. No.: 511/21 Invoice No. : 4/715
 Chalan No.:- Date:- Amount Remitted:-
 Name of Treasury:-